

# Model PCL

**AC Current Transducer**  
**0-600 Amps ac to produce 4-20 mA dc**

## Operating Range

Input 0 to 100 thru 600 Amps ac.  
Output: 4-20 mA dc.

## Frequency

50-400 Hz.

## Ambient Temperature Range

Effect on accuracy  $\pm 0.02\%$ /°C  
Operating: -30 °C to +60 °C  
Storage: -55 °C to +85 °C

## Insulation level

600 Volts, 10 kV BIL full wave

## Accuracy

$\pm 0.05\%$  F.S. maximum.

1 % max. peak ripple on output.

Response Time: <150 ms (10 % to 90 %)

Output load ( $R_L$ ): 0-1,000  $\Omega$ .

Maximum output: 30 mA dc.

Supply Voltage Range: 120 Vac  $\pm 10\%$ .

Terminal are brass studs No. 8-32  
with one flatwasher, lockwasher  
and regular nut.

Approximate weight 3.0 lbs.



REGULATORY AGENCY APPROVALS




The PCL transducers accurately converts a sinusoidal ac input current to a proportional dc output current. The high performance integrated circuit amplifiers achieve a content current output, insensitive to a variable impedance load. This allows the PCL to be easily applied to remote instrumentation, motor control and energy management installations. The output signal (4 to 20mA dc) can be transmitted over long distances with no loss accuracy


## Model PCL 0-600

Model Number	Input Current Range
Previous for 0-5 thru 0-75	
PCL 100	0-100
PCL 150	0-150
PCL 200	0-200
PCL 300	0-300
PCL 400	0-400
PCL 600	0-600
0221B00777	Mtg. Bracket Kit

*For load currents which are greater than 600 A the PCL-5 may be used in conjunction with separate higher ratio C.T.'s having a rated 5A secondary.*

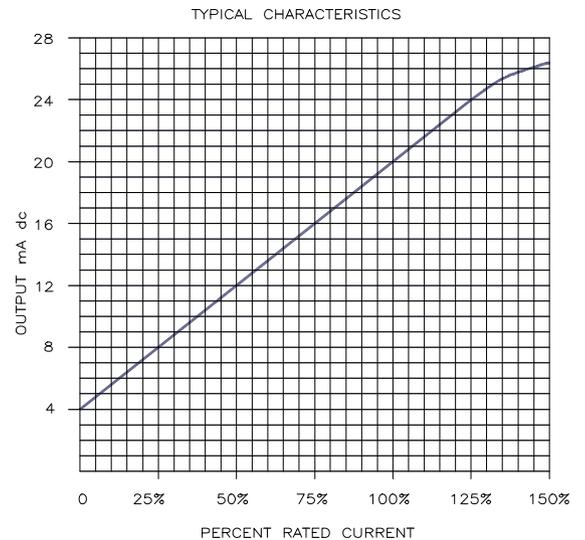

## Model PCL 0-600 - Typical Connection Diagram

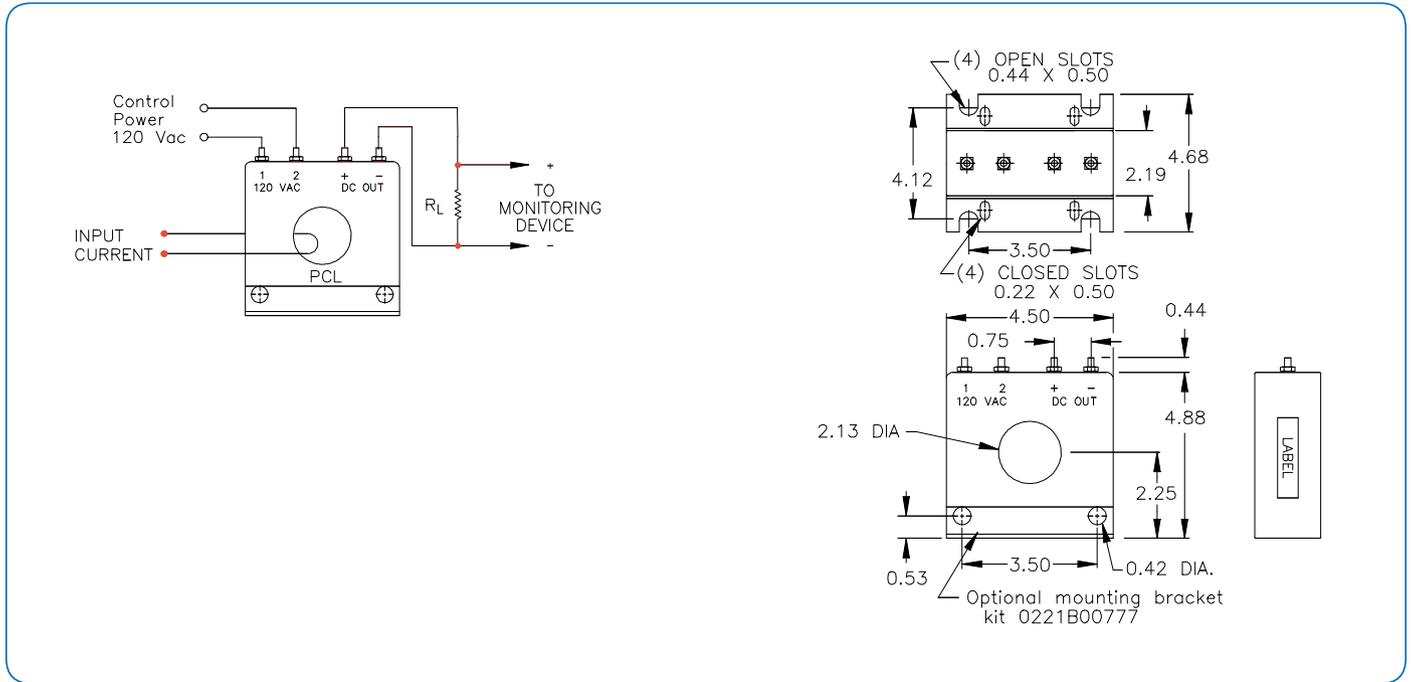

**Do not apply around or remove from Hazardous LIVE conductors.**

### Cleaning:

Remove dust with a damp cloth. Do not spray with any chemicals.

### Caution:

Proper safety precautions must be followed during installation by a trained electrician. Never install or remove while bus is energized. Protective equipment must be used if hazardous parts in the installation where measurement is to be carried out could be accessible.

### Application

Calculating	$I_m$ = ac Amps measured $I_o$ = mA dc out of PCL
Rated Input	CT primary Rating (when monitoring a CT)
Rated Input	PCL Primary Rating (when monitoring direct)
Where:	$I_m$ = Rated input X $((I_o - 4)/16)$

### GEGridSolutions.com

Grid-AIS-L4-ITL\_Model\_PCL\_0\_600-1125-2017\_07-EN. © Copyright 2017. General Electric Company and Instrument Transformers LLC reserve the right to change specifications of described products at any time without notice and without obligation to notify any person of such changes.

### Worldwide Contact Center

Web: [www.GEGridSolutions.com/contact](http://www.GEGridSolutions.com/contact)  
 Phone: +44 (0) 1785 250 070  
 USA and Canada: +1 (0) 800 547 8629  
 Europe, Middle East and Africa: +34 (0) 94 485 88 00

